

Preservation of historic structures using Screw-Pile foundations

Alan J. Lutenegger

Department of Civil & Environmental Engineering, University of Massachusetts, Amherst, Ma. USA

James H. Kemper

Hubbell Power Systems, Centralia, Mo. USA

ABSTRACT: The structural integrity of historic buildings is often compromised over the life of the structure as a result of foundation deformations over time. Foundation deformations can be created by a number of problems related to the subsurface conditions, groundwater removal, softening of the bearing soils, or simply from long-term soil consolidation. Often times, such deformations produce large and usually differential settlements that lead to a condition of imminent collapse or unsafe conditions and place the structure in jeopardy. The preservation of these structures requires innovative foundation repair approaches that will not unnecessarily disrespect the historic nature of the structure. This paper describes the preservation of several historic structures by foundation underpinning using helical Screw-Pile foundations. Five case histories are presented where helical Screw-Piles were used to preserve the foundations of structures ranging in age and use from the stone gate house of an 11th century castle to a late 19th century university brick classroom. The cases illustrate the economic and effective use of helical Screw-Piles to retrofit the foundations with minimal intrusion to the structures. For each case, a brief historical review of the structure is presented and a summary of the foundation problems and site conditions are given along with a description of the Screw-Piles selected for the repair work.

1 INTRODUCTION

Historic structures, like all structures, can undergo settlements over their life that are generally produced from two primary sources. Settlement can occur as a result of the slow long-term consolidation process that occurs if a structure has been built on soft soils such as clays or organic soils. Alternatively, settlements can occur if subsurface changes have occurred at a site for example by lowering the water table or removing support from under or adjacent to a structure by recent excavations. No matter the cause, the result of settlements is generally structural distress that must be addressed before additional problems arise or for that matter a partial or complete failure occurs. Structural intervention to provide an engineering solution in these cases generally involves some form of underpinning although other methods, such as soil extraction which was successfully used to stabilize the bell tower at Pisa (Burland et al. 2003).

The foundation restoration of historic structures can present some unique challenges to the engineer to devise appropriate remedial support techniques. These challenges often include such issues as: unknown existing foundation conditions, unknown or unexpected soil and groundwater conditions, heavy loads,

limited access, sensitive status of the historic fabric of the structure, (Ciancia, et al. 2006) but can also include; maintaining adequate support during restoration, sensitivity to specific construction activities, such as vibration or noise, and the desire to create the least amount of intrusion to the structure or disrupt the current use of the structure. Historic structures can be particularly sensitive to structural intervention to stabilize the foundation as in some cases, the structural connection between the foundation and the overlying structure may also be weakened or may simply be less sound from the original construction techniques used during construction.

A number of examples may be cited in which foundation repairs have been made to historic masonry structures using a wide variety of techniques, including, drilled micropiles, jacked minipiles, jet grouting, chemical grouting and conventional piles (e.g., Dooff et al. 1995; Avellan and Lange 1997; Chartres 1997; Rodriguez Ortiz and Monteverde 1997; Niehoff 2004). Five case histories are presented in this paper that illustrate the application of Helical Screw-Piles for the preservation of historic masonry structures. The cases represent applications in a wide range of soil conditions and a wide range of loads and demonstrate that Screw-Pile present a unique

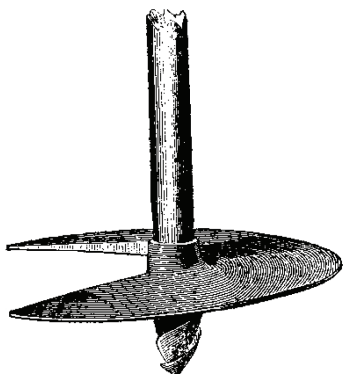


Figure 1. Typical geometry of Screw Pile used by Mitchell (1836–1880).

approach for engineers who are faced with such problems.

2 SCREW-PILE FOUNDATIONS

Screw-Pile foundations are a product of mid 19th century Victorian engineering. Most historians give credit to the use of Screw-Piles as viable foundations to Alexander Mitchell, a Scottish self-taught engineer and contractor who initially developed iron Screw-Piles for use as foundations for offshore lighthouse around the coasts of England. Mitchell (1848) described the mechanics of the functionality of Screw-Piles as:

“Whether this broad spiral flange, or “Ground Screw,” as it may be termed, be applied ...to support a superincumbent weight, or be employed ...to resist an upward strain, its holding power entirely depends upon the area of its disc, the nature of the ground into which it is inserted, and the depth to which it is forced beneath the surface.”

Figure 1 shows the geometry of a typical Screw-Pile used by Mitchell at the Maplin Sands Lighthouse in the Thames estuary. All of the Screw-Piles used by Mitchell were fabricated by a combination of cast-iron plates and wrought-iron shafts, both of which could be readily manufactured in England during this time period. In nearly every case of Screw-Pile installation before about 1900, the Screw-piles were installed by manual labor using a large capstan attached to the top of the shaft and turned by as many as 40 men. No vertical load was applied to assist the installation, the pitch of the screw blade was sufficient to produce advance of the crew with rotation of the shaft.

During the mid to late 19th century, Screw-Piles were used throughout the world to provide support

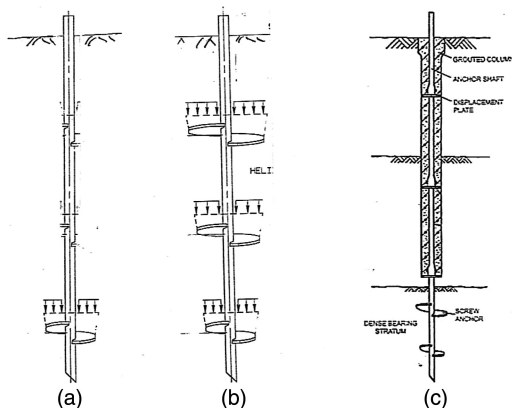


Figure 2. Configuration of modern Screw-Piles: (a) single helix; (b) multi-helix; (c) grouted shaft.

for offshore and onshore lighthouses, ocean front piers, bridges, slope stabilization and underpinning. Duckham (1889) described the use of Screw-Pile foundations to underpin the town hall at Great Yarmouth which had undergone several inches of settlement.

Since the early 1950s, the Screw-Pile has taken on a different form, to solve a different kind of problem. A.B. Chance recognized that a helical screw element could be used to provide tension support for electrical transmission tower and other tall structures and developed a screw anchor industry that still is in use today. Since about the 1970s however, Screw-Pile foundations have returned to applications similar to those in which they were originally developed by Mitchell and others. Modern Screw-Piles have a variety of geometries and applications and include both single helical and multi-helix configurations on both square shafts and round shafts. With the advent of modern hydraulics in the construction industry which largely took off after the 2nd World War, Screw-Piles can now be installed with ease using a variety of commonly available construction equipment.

Modern Screw-Piles have a variety of names, such as Helical Pier, Screw Anchor, or Helical Pile but they are all generally fabricated as one of three general configurations as shown in Figure 2. They may consist of a single helical element, a multi-helix lead section or a helical lead section with a grout column. The central shaft may be square or round. If a grout column is used, an appropriate amount of time is allowed for the grout to achieve sufficient strength before load transfer. Grout columns may be used to provide additional load capacity, working in combination with the lead helical section, or they may be used to simply transfer the load to the lead helical section, as in the case of short Screw-Piles end-bearing on rock or other hard material. The grout column typically consists of a Portland cement based neat grout or some similar material.

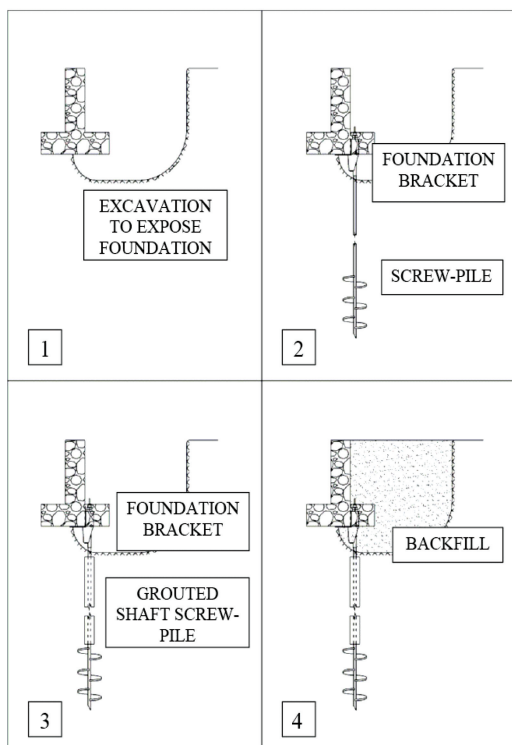


Figure 3. Sequence of underpinning existing foundations with Screw-Piles.

Crocker (2005) previously described the potential for using helical piers in historic settings.

The Screw-Piles are generally attached to existing foundations using a foundation bracket that can be bolted to the existing foundation and then attached to the shaft of the Screw-Pile. In some cases, strengthening of the existing foundations, which often consist of stone or other masonry, may be necessary using a thread bar or a grouted bar before installing the Screw-Pile support system. This may be particularly important given the age of most of the structures that predate the use of concrete for foundations.

3 SEQUENCE OF FOUNDATION UNDERPINNING USING SCREW-PILES

When using Screw-Piles for underpinning, it is first necessary to make a small excavation to expose the base of the existing foundation. The Screw-Pile is then installed using hydraulic torque motor to the required design depth or a sufficient depth as determined by the installation torque to develop sufficient load capacity. A foundation "L" bracket is then attached to the shaft of the pile and to the existing foundation to provide a

structural connection between the two and provide for load transfer.

If appropriate, given the condition of the structure and the degree of distress, a small amount of lifting may also be performed using hydraulic jacking system to provide vertical adjustment to the structure and preloading of the screw-pile. This load is then locked off and the final position of the foundation bracket is achieved. If needed, the existing foundation may also be reinforced using either thread bars or grouted bars inserted into the existing foundation blocks or a small section of reinforced concrete may be cast in place and tied to the existing foundation. The underpinning sequence is illustrated in Figure 3. Note that Figure 3 illustrates that the Screw-Pile can include a grout column around the central shaft or it may be installed without a grout column, depending on the soil conditions and the design of the pile for bearing capacity.

4 CASE HISTORIES

Table 1 gives a summary of the five historic masonry structures described in this paper. It should be remembered that what may be considered as an historically significant structure may vary depending on the current usage of a particular structure, the age, location and setting of the structure in context to the surrounding environment. A description of each of the cases will be given describing the state of distress and the intervention applied.

4.1 Case no.1 – Mark Twain Hotel, Hannibal, Missouri

The Mark Twain Hotel in Hannibal, Missouri is a four story brick building built in 1906. The existing structure was founded on timber piles. The Hotel was being converted to senior housing and required the addition of two new four story stairways and the underpinning of an existing stairway. It was decided not to disrupt the existing structure by attaching the new stairways to the existing building by the new construction. Soils at the site consist of low plasticity silts and silty clays in the upper 9.1 m which overly loose to medium dense alluvial sand and gravel extending to about 18.3 m. The ground water was located between 4.6 and 6.1 m below ground surface.

Screw-Piles with grouted shafts (Pulldown Micropiles) were installed to the sand and gravel to provide support. Triple helix lead sections (8/10/12) were used with either a 38.1 or 44.4 mm square shaft to depths ranging from 5.8 to 16.8 m although most were between 9.1 and 16.8 m in length. A 127 mm diameter grout column was used. A total of 21 screw-piles were installed using either heavy duty foundation brackets

Table 1. Summary of case histories.

Case no.	Structure	Location	Age of structure
1	Mark Twain Hotel	Hannibal, Missouri	1906
2	Ralls County Courthouse	New London, Missouri	1857/1936
3	Our Lady of Lourdes Church	Minneapolis, Minnesota	1854–1857
4	Forest Lodge, Hulne Park	Alnwick, Northumberland	1853
5	Engineering Building East University of Missouri	Columbia, Missouri	1892

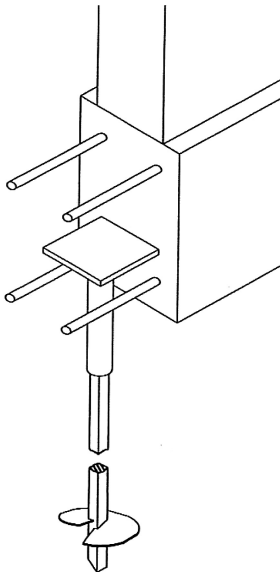


Figure 4. New construction bracket attached to Screw-Pile for new foundation or extension of existing foundation.

in the case of the existing stairwell or new construction brackets as shown in Figure 4 for the new construction.

4.2 Case no.2 – Ralls County Courthouse, New London, Missouri

The Ralls County Courthouse, located in New London, Missouri, is a limestone structure built in 1857 with a limestone addition added in 1936. Because of the settlement of the addition away from the original structure had become a concern it was necessary to underpin the addition to arrest further settlement. Based on test borings performed at the site, the soils consisted of silty clay and clay with a layer of limestone present at a depth of about 5.2 m. No groundwater was encountered in test borings at the time of drilling. Estimated settlements at the time of repair were on the order of 44.4 mm.

A total of 57 screw-piles were installed to depths ranging from 2.4 to 7.6 m below existing foundations

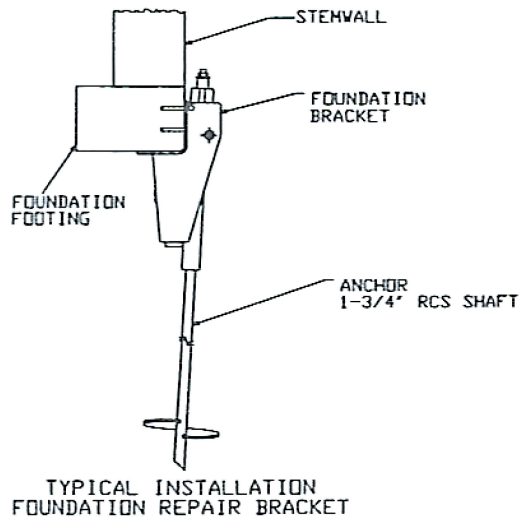


Figure 5. Heavy duty foundation bracket attached to Screw-Pile and existing foundation.

to support loads ranging from 50 kips to 86 kips. Both double and triple helix Screw-Piles with 44.4 mm square shafts were installed around the perimeter of the structure to develop the required loads. While most piles were installed along the footings from the outside, a few piles were required inside the structure using a hand held portable torque head. Piles were attached to the existing foundations which were located at a depth of about 2.7 m below ground surface using a heavy duty foundation bracket assembly, as shown in Figure 5. Piles were spaced approximately 1.5 m apart around the outside of the structure. Installation torque was monitored on each pile. A small excavation was required at each location to allow the foundation bracket to be attached to the existing foundation.

4.3 Case no.3 – Our Lady of Lourdes Church, Minneapolis, Minnesota

Our Lady of Lourdes Church in Minneapolis, Minnesota is the oldest continuously used church in the city of Minneapolis and was built between 1854



Figure 6. Heavy duty foundation bracket attached to existing foundation.

and 1857 in the Greek temple style. The building is built of native limestone and was designated a U.S. historic landmark in 1934. Soils at the site consist of about 2.5 m of sandy fill overlying dense gravelly sand. At the time of drilling no water table was encountered in the upper 10 m. During installation of new water service to the church, the existing foundation at one location was undermined which caused some settlement of a wall.

Screw-Piles were used to underpin the foundations to prevent additional subsidence. Triple-helix screw-piles (8/10/12) with 44.4 mm square shafts were installed to a depth of about 4.6 m below existing foundation levels and were attached using heavy duty foundation brackets from the outside of the structure to provide load capacity of 120 kips each. Figure 6 shows a typical heavy duty foundation bracket attached to an existing foundation.

4.4 Case no.4 – Forest Lodge, Hulne Park, Alnwick, Northumberland, U.K.

Forest Lodge is the gate house into Hulne Park, which is part of the Duke of Northumberland's estate in Northumberland, U.K. The Lodge was built in 1853 of local stone. Over the years, the north wing of the gate house had experienced excessive settlement. To prevent additional settlement, Screw-Piles with grouted were installed. The soil at the site consisted predominantly of miscellaneous fill overlying bedrock at about 7.5 meters below the ground surface.

Screw-Piles consisted of twin helix lead sections (10/12) with a 38.1 mm square shaft with a grouted column as shown in Figure 8. Displacement plates were used to produce a 100 mm grout column. The piles were installed to bedrock which varied between 6 and 8 meters below existing foundations so that they would act in end bearing. Work was performed both inside the cellar of the gate house which included a



Figure 7. Foundation bracket and leveling jack used at Forest Lodge.

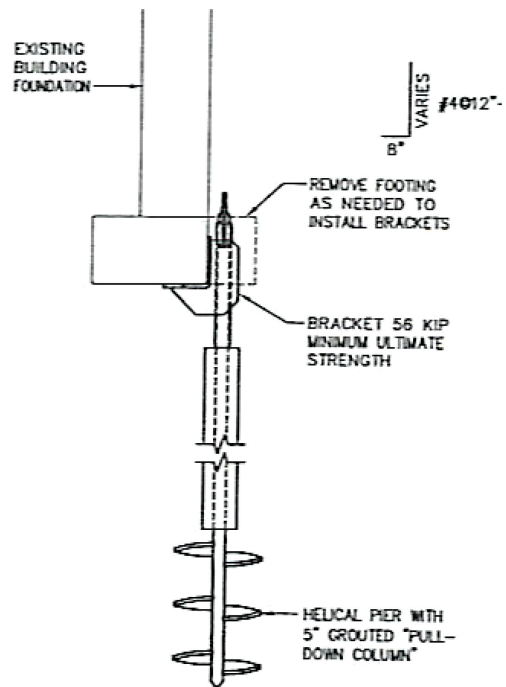


Figure 8. Screw-Pile with grouted shaft used for underpinning.

vaulted ceiling with a kitchen above using a hand-held portable hydraulic torque head. A total of fourteen screw-piles were installed to support the structure. Foundation brackets were then attached to the shaft of the screw-piles and then bolted to the existing foundation stones.

Figures 9 and 10 show some of the Screw-Piles and foundation brackets installed at the Forest Lodge Gate House during the underpinning and restoration work.



Figure 9. Installing Screw-Piles at Forest Lodge.



Figure 10. Corner of Forest Lodge Gate House after installation of Screw-Piles and foundation brackets.

4.5 Case no.5 – Engineering Building East University of Missouri, Columbia, Missouri

Engineering Building East is located on the University of Missouri campus in Columbia, Missouri and is a two story brick structure with a central bell tower built in 1892. Because of movements of the building that were thought to be the result of expansive soils in the area and changes in the building drainage system the building and developed some severe distress. Soils at the site consisted of silty clays, sandy silt in the upper zone with weathered limestone rock at depths between 6.1 and 11.0 m deep. The structure had a basement. One of the issues imposed during the restoration work was the need for the building to remain in use during the foundation repair.

Repair of the existing foundation required installation of screw-piles both inside and outside the structure in areas of limited access. Twin helix Screw-Piles with 44.4 mm square shafts were used spaced on 1.2 m centers along the building walls and 0.6 to 0.9 m centers

beneath the bell tower. A skid loader was used to install the Screw-Piles on the outer perimeter while a portable hand held hydraulic torque head was used inside, where the work space was limited. Screw-Piles were attached to a heavy duty foundation bracket attached to the existing masonry rubble foundation which was then encased in a new cast-in-place concrete block to tie the existing foundation to the Screw-Piles.

Table 2 gives a summary of the different configurations of Screw-Piles used for each of the cases.

5 ADVANTAGES OF SCREW-PILES FOR STRUCTURAL REPAIR/RESTORATION

The use of Screw-Piles for the structural restoration and underpinning of historic structures has a number of advantages that in most cases cannot be realized by most traditional underpinning techniques. One of the highest priorities for this type of work is preserving the historic fabric of the existing structure during construction activities.

5.1 *Minimal disruption to existing structure*

The installation of Screw-Piles is generally minimally invasive work involving slow rotation using a high torque hydraulic torque head. There are no soil cuttings to dispose of from installation of the Screw-Piles. Soil from the excavation to expose the existing foundation may be carefully stockpiled and used as backfill at the completion of the repair work. In some cases, the structure may still be used while the work is in progress.

5.2 *Flexibility of geometry*

As indicated with cases presented, Screw-Piles are available in a variety of configuration, including single and multi-helix lead sections with a variety of diameters. This allows considerable flexibility for the designer to select an appropriate geometry for a specific project. Increasing the helix diameter and/or number of helices or modifying the installation length to achieve the required load capacity is generally very easy. In cases where increased bending stiffness is needed to support eccentric loading, the use of the grouted shaft may be desirable. Even when a grouted shaft is used, the additional equipment needed to mix and place the grout is minimal.

5.3 *Minimal construction vibration*

There are essentially no vibrations produced by the hydraulic plant during installation of the Screw-Piles. This may be particularly important in situations where the existing structure may be sensitive to construction vibrations. Most Screw-Piles for restoration work may

Table 2. Screw-Piles used in case histories.

Case no.	Screw-Pile configuration	Engineer	Foundation contractor
1	Grouted shaft triple-helix (8/10/12)	Klinger & Associates, P.C., Hannibal, Mo.	Tri-State Concrete Correction, Co.
2	Square shaft double- and triple-helix	Klinger & Associates, P.C., Hannibal, Mo.	Tri-State Concrete Correction, Co.
3	Square shaft triple-helix (8/10/12)	Meyer Borgman & Johnson, Inc.	Atlas Foundation Co.
4	Grouted shaft double-helix (10/12)	Patrick Parson Ltd.	Subsurface Technologies, Ltd.
5	Square shaft double-helix	Structural Engineering Association, Kansas City, Mo.	Kidwell Construction and Pro Services.

be installed with small light duty construction equipment such as a rubber track mini excavator or skid steer or portable hand held equipment.

5.4 Installation in high groundwater

The installation of Screw-Piles is unaffected by high ground water condition since no excavation is required below the foundation level. Of course is water is above the foundation level, directing may be required as in most other replacement methods.

5.5 Construction in confined space

As demonstrated by the description of several of the cases described in this paper and many other projects, Screw-Piles may be installed in areas of limited access or low head room. The portable equipment can easily be managed by a single operator. Short extension section may be use inside to install the Screw-Piles to the required depth. The power unit used to operate the portable torque motor can be placed outside and hydraulic hoses can be routed through a window or small opening in the structure.

5.6 Field verification of capacity for QC

During installation the hydraulic torque can be monitored to provide a record of the installation torque. This attribute of Screw-Piles allow for field verification of the soil conditions at each pile location and for verification of load capacity. This is particularly important in regard to historic structures where the soil conditions under the structure are often unknown and difficult to determine, especially at interior locations. The installation torque record provides an excellent quality control tool and should be included as a part of every project.

5.7 Rapid installation and construction

In most soil conditions, Screw-Piles may be installed very quickly. A typical installation time using conventional construction equipment such as a skid

steer or mini excavator is about 1 hour for a 10 m length of pile. Only a small amount of additional time is needed when using a grouted shaft Screw-Pile.

5.8 Instant capacity/load transfer

In most soils Screw-Piles allow for load transfer to essentially take place as soon as the pile has been installed. This can be important in some cases where emergency repairs are needed before additional damage can occur. In the case of grouted shaft Screw-Piles, sufficient time, usually 5 to 7 days may be required for the grout to attain sufficient strength before being loaded.

6 CONCLUSIONS

Several case histories have been presented describing the use of helical Screw-Piles for providing structural repair and restoration of the integrity of the foundation of historic structures. The primary advantages of Screw-Piles in this application, which often involves sensitive structures, is the minimal disruption to the historic fabric of the existing structure, the minimal intrusion to the site and surroundings, minimal noise and vibrations that can accompany other more invasive methods and the speed at which the work may be performed. The methods described in this paper may be applied to other structures to achieve a cost effective intervention for preserving the structural stability of historic structures that have undergone or are continuing to exhibit additional movements because of subsurface conditions.

ACKNOWLEDGEMENTS

The authors wish to gratefully acknowledge the assistance of a number of individuals who provided details and important project information on these projects; Ron King of Tri-State Concrete Construction Co. Quincy, Illinois; Don Bobbit, P.E. of Centralia, Missouri; Mike Moeller, Structural Anchor

Supply/Atlas Foundation Company; and Duncan Robson, Subsurface Technologies Ltd, Alnwick, Northumberland.

REFERENCES

- Avellan, K., and Lange, K., 1997. St.-John's Church, Tartu, Estonia – Underpinning of Tower. *Geotechnical Engineering for the Preservation of Monuments and Historic Sites*: 521–525.
- Burland, J.B., Jamiolkowski, M., and Viggiani, C., 2003. The Stabilization of the Leaning Tower of Pisa. *Soils and Foundations*, 43 (5): 63–80.
- Chartres, F.R.D., 1997. Monitoring the Installation of Piles Beneath the Round Tower, Windsor Castle, U.K. *Geotechnical Engineering for the Preservation of Monuments and Historic Sites*: 349–356.
- Ciancia, A.J., Biesiadecki, G.L., and Ladd, B.E., 2006. Challenges of Underpinning Two Historic Landmark Buildings. *Practice Periodical on Structural Design and Construction*, ASCE, 11(3): 142–148.
- Crocker, E.E., 2005. Non-invasive Underpinning Technologies in Historic Settings. *Proceedings of the 4th International Seminar on Structural Analysis of Historical Constructions*: 821–828.
- Drooff, E.R., Furth, A.J., and Scarborough, J.A., 1995. Jet Grouting to Support Historic Structures. *Foundation Upgrading and Repair for Infrastructure Improvement*, ASCE: 42–55.
- Duckham, F.E., 1889. Underpinning Great Yarmouth Town Hall. *Minutes of the Proceedings of the Institution of Civil Engineers*, 98: 372–374.
- Mitchell, A., 1848. On Submarine Foundations; particularly Screw-Pile and Moorings, *Civil Engineer and Architects Journal*, 12: 108–149.
- Niehoff, J.W., 2004. Stabilization of a Historic Structure Founded on an Unstable Mesa. *Proceedings of the 5th International Conference on Case Histories in Geotechnical Engineering*, paper no. 1.05, 6 pp.
- Rodriguez Ortiz, J.M., and Monteverde, P.R., 1997. A Review of Recent Spanish Interventions in Monuments. *Geotechnical Engineering for the Preservation of Monuments and Historic Sites*: 499–508.